

SUZHOU TRYBA BUILDING MATERIALS TECHNOLOGY CO., LTD

THERMAL PERFORMANCE TEST REPORT

SCOPE OF WORK

THERMALLY BROKEN ALUMINUM TILT TURN

REPORT NUMBER

R7714.01-116-46 R0

TEST DATE

07/15/25

ISSUE DATE

08/05/25


PAGES

29

DOCUMENT CONTROL NUMBER

RTTDS-R-AMER-Test-8197(a) (02/04/25)

©2017 INTERTEK

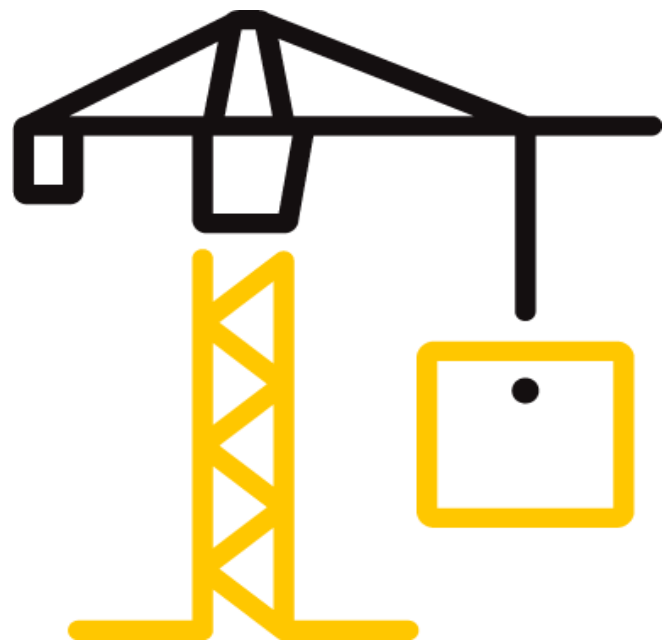

TEST REPORT FOR SUZHOU TRYBA BUILDING MATERIALS TECHNOLOGY CO., LTD

Report No.: R7714.01-116-46 R0
Date: 08/05/25

REPORT ISSUED TO

SUZHOU TRYBA BUILDING MATERIALS TECHNOLOGY CO., LTD

Room 3600-3606, 3608, Building 1, Golden River Building, No. 35,
Shishan Road, Suzhou (China)

SECTION 1


SCOPE


SERIES/MODEL: Thermally Broken Aluminum Tilt Turn
TYPE: Dual Action (Tilt Turn)

Architectural Testing, Inc. (an Intertek company) dba Intertek Building & Construction (B&C) was contracted by Suzhou TRYBA Building Materials Technology Co., LTD to evaluate the thermal performance per NFRC 102-2023. Results obtained are tested values and were secured by using the designated test method. Testing was conducted at Intertek B&C test facility in York, Pennsylvania.

Intertek B&C will service this report for the entire test record retention period. The test record retention period ends five years after the test date. Test records, such as detailed drawings, datasheets, or other pertinent project documentation, will be retained for the entire test record retention period. Representative samples of the test specimen will be retained by Intertek B&C for a minimum of two and a half years from the submittal date to the Inspection Agency and no more than five years from the test date.

For INTERTEK B&C:

COMPLETED BY	Ryan P. Moser Technician Team Lead,
TITLE	IIRC
SIGNATURE	 <small>Digitally Signed by: Ryan P. Moser</small>
DATE	08/05/25

REVIEWED BY	Shon W. Einsig
TITLE	Project Lead, IIRC
SIGNATURE	 <small>Digitally Signed by: Shon W. Einsig</small>
DATE	08/05/25

RPM:pan

This report is for the exclusive use of Intertek's Client and is provided pursuant to the agreement between Intertek and its Client. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. Intertek assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense or damage occasioned by the use of this report. Only the Client is authorized to permit copying or distribution of this report and then only in its entirety. Any use of the Intertek name or one of its marks for the sale or advertisement of the tested material, product or service must first be approved in writing by Intertek. The observations and test results in this report are relevant only to the sample(s) tested. This report by itself does not imply that the material, product, or service is or has ever been under an Intertek certification program.

TEST REPORT FOR SUZHOU TRYBA BUILDING MATERIALS TECHNOLOGY CO., LTD

Report No.: R7714.01-116-46 R0

Date: 08/05/25

SECTION 2

SUMMARY OF TEST RESULTS

Standardized U-factor (Ust): 0.27 Btu/hr-ft²·F (CTS Method)

SECTION 3

TEST SPECIMEN SUMMARY

SERIES/MODEL	Thermally Broken Aluminum Tilt Turn
TYPE	Dual Action (Tilt Turn)
OVERALL SIZE	47-1/4" x 59" (1200 mm x 1499 mm) (Model Size)
NFRC STANDARD SIZE	47.2" x 59.1" (1200 mm wide x 1500 mm high)
TEST SAMPLE SUBMITTED BY	Client
TEST SAMPLE SUBMITTED FOR	Validation for Initial Certification (Production Line Unit) & Plant Qualification

SECTION 4

TEST METHOD

The specimens were evaluated in accordance with the following:

NFRC 102-2023, Procedure for Measuring the Steady-State Thermal Transmittance of Fenestration Systems

SECTION 5

MATERIAL SOURCE/INSTALLATION

The test specimen was provided by the client.

The test sample was installed in a vertical orientation, the exterior of the specimen was exposed to the cold side.

SECTION 6

LIST OF OFFICIAL OBSERVERS

NAME	COMPANY
Shon W. Einsig	Intertek B&C
Ryan P. Moser	Intertek B&C

TEST REPORT FOR SUZHOU TRYBA BUILDING MATERIALS TECHNOLOGY CO., LTD

Report No.: R7714.01-116-46 R0

Date: 08/05/25

SECTION 7

TEST SAMPLE DESCRIPTION

FRAME

MATERIAL	AT (0.89"): Aluminum w/ Polyamide Thermal Breaks		
SIZE	47-1/4" x 59" (Model Size)		
DAYLIGHT OPENING	N/A	GLAZING METHOD	N/A
EXTERIOR COLOR	Maroon	EXTERIOR FINISH	Paint
INTERIOR COLOR	Maroon	INTERIOR FINISH	Paint
CORNER JOINERY	Mitered / Keys / Sealed		

VENT

MATERIAL	AT (0.89"): Aluminum w/ Polyamide Thermal Breaks		
SIZE	45-3/8" x 57-1/8"		
DAYLIGHT OPENING	39-7/8" x 51-5/8"	GLAZING METHOD	Interior
EXTERIOR COLOR	Maroon	EXTERIOR FINISH	Paint
INTERIOR COLOR	Maroon	INTERIOR FINISH	Paint
CORNER JOINERY	Mitered / Keys / Sealed		

GLAZING INFORMATION

LAYER 1	1/4"	China Southern Glass SJ70s-1 (e=0.028*, #2)	
GAP 1	0.44"	TS-D: Technoform SP13 Spacer	90% Argon*
LAYER 2	1/4"	Clear	
GAP 2	0.44"	TS-D: Technoform SP13 Spacer	90% Argon*
LAYER 3	1/4"	Clear	
GAS FILL METHOD	Single-Probe Method*		

**Stated per the client/manufacturer and can affect the validity of results*

N/A Non-Applicable

TEST REPORT FOR SUZHOU TRYBA BUILDING MATERIALS TECHNOLOGY CO., LTD

Report No.: R7714.01-116-46 R0

Date: 08/05/25

SECTION 7 (CONTINUED)

TEST SAMPLE DESCRIPTION (CONTINUED)

WEATHERSTRIPPING

DESCRIPTION	QUANTITY	LOCATION
Center gasket	1 Row	Head, sill and jambs
Flexible hollow bulb gasket	1 Row	Vent perimeter
Single-fin gasket	1 Row	Frame perimeter
Filler gasket	1 Row	Frame perimeter
Glazing gasket	1 Row	Exterior glazing perimeter
Glazing gasket	1 Row	Interior glazing perimeter

HARDWARE

DESCRIPTION	QUANTITY	LOCATION
Multi-point lock assembly	1	Lock stile
Metal keeper	4	Three per lock jamb, one per hinge jamb
Dual-action hinge	2	Head/top rail, sill/bottom rail
Single-arm hinge	1	Head/top rail
Metal ramp	1	Sill

DRAINAGE

DRAINAGE METHOD	SIZE	QUANTITY	LOCATION
Weepslot	1.25" x 0.38"	2	Sill face

TEST REPORT FOR SUZHOU TRYBA BUILDING MATERIALS TECHNOLOGY CO., LTD

Report No.: R7714.01-116-46 R0

Date: 08/05/25

SECTION 8

THERMAL TRANSMITTANCE (U-FACTOR): MEASURED TEST DATA

HEAT FLOWS

1. Total Measured Input into Metering Box (Qtotal)	440.49 Btu/hr
2. Surround Panel Heat Flow (Qsp)	52.17 Btu/hr
3. Surround Panel Thickness	4.00 inches
4. Surround Panel Conductance	0.0478 Btu/hr·ft ² ·F
5. Metering Box Wall Heat Flow (Qmb)	4.53 Btu/hr
6. EMF vs Heat Flow Equation (equivalent information)	0.0119*EMF + -0.037
7. Flanking Loss Heat Flow (Qfl)	15.18 Btu/hr
8. Net Specimen Heat Loss (Qs)	368.60 Btu/hr

AREAS

1. Test Specimen Projected Area (As)	19.36 ft ²
2. Test Specimen Projected Frame Area (Af)	5.06 ft ²
3. Test Specimen Projected Glazing Area (Ag)	14.30 ft ²
4. Metering Box Opening Area (Amb)	36.11 ft ²
5. Metering Box Baffle Area (Ab1)	33.94 ft ²
6. Surround Panel Interior Exposed Area (Asp)	16.75 ft ²

TEST CONDITIONS

1. Average Metering Room Air Temperature (th)	69.80 F
2. Average Cold Side Air Temperature (tc)	-0.41 F
3. Average Guard/Environmental Air Temperature	71.24 F
4. Metering Room Average Relative Humidity	10.27 %
5. Metering Room Maximum Relative Humidity	10.40 %
6. Metering Room Minimum Relative Humidity	10.12 %
7. Measured Cold Side Wind Velocity (Perpendicular Flow)	12.66 mph
8. Measured Warm Side Wind Velocity (Parallel Flow)	0.04 mph
9. Measured Static Pressure Difference Across Test Specimen	0.00" ± 0.04" H ₂ O

AVERAGE SURFACE TEMPERATURES

1. Metering Room Surround Panel	65.20 F
2. Cold Side Surround Panel	0.11 F

RESULTS

1. Thermal Transmittance of Test Specimen (Us)	0.27 Btu/hr·ft ² ·F
2. Standardized Thermal Transmittance of Test Specimen (Ust)	0.27 Btu/hr·ft ² ·F

TEST REPORT FOR SUZHOU TRYBA BUILDING MATERIALS TECHNOLOGY CO., LTD

Report No.: R7714.01-116-46 R0

Date: 08/05/25

SECTION 9**THERMAL TRANSMITTANCE (U-FACTOR): CALCULATED TEST DATA****CTS METHOD RESULTS**

1. Warm Side Surface Emittance of CTS (e1)	0.84
2. Warm Side Area-Weighted Surface Emittance of Specimen Frame (ef1)	0.90
3. Warm Side Area-Weighted Surface Emittance of Specimen Glazing (eg1)	0.84
4. Warm Side Surface Emittance of Surround Panel (esp1)	0.90
5. Warm Side Area-Weighted Surface Emittance in View of the Baffle (es1)	0.88
6. Warm Side Baffle Emittance (eb1)	0.92
7. Cold Side Baffle Emittance (eb2)	N/A
8. Equivalent Warm Side Surface Temperature (t1)	55.47 F
9. Equivalent Cold Side Surface Temperature (t2)	3.30 F
10. Warm Side Baffle Surface Temperature	68.24 F
11. Cold Side Baffle Surface Temperature	N/A F
12. Measured Warm Side Surface Conductance (hh)	1.33 Btu/hr·ft ² ·F
13. Measured Cold Side Surface Conductance (hc)	5.13 Btu/hr·ft ² ·F
14. Test Specimen Thermal Conductance (Cs)	0.36 Btu/hr·ft ² ·F
15. Convection Coefficient (Kc)	0.32 Btu/(hr·ft ² ·F ^{1.25})
16. Radiative Test Specimen Heat Flow (Qr1)	195.58 Btu/hr
17. Conductive Test Specimen Heat Flow (Qc1)	173.02 Btu/hr
18. Radiative Heat Flux of Test Specimen (qr1)	10.10 Btu/hr·ft ² ·F
19. Convective Heat Flux of Test Specimen (qc1)	8.94 Btu/hr·ft ² ·F
20. Standardized Warm Side Surface Conductance (hsth)	1.25 Btu/hr·ft ² ·F
21. Standardized Cold Side Surface Conductance (hstc)	5.28 Btu/hr·ft ² ·F
22. Standardized Thermal Transmittance (Ust)	0.27 Btu/hr·ft ² ·F

SECTION 10**TEST DURATION**

1. The environmental systems were started at 15:12 hours, 07/14/25.
2. The test parameters were considered stable for two consecutive four hour test periods from 22:03 hours, 07/14/25 to 06:03 hours, 07/15/25.
3. The thermal performance test results were derived from 02:03 hours, 07/15/25 to 06:03 hours, 07/15/25.

TEST REPORT FOR SUZHOU TRYBA BUILDING MATERIALS TECHNOLOGY CO., LTD

Report No.: R7714.01-116-46 R0

Date: 08/05/25

SECTION 11

GLAZING DEFLECTION

	VENT EXT. / INT.
EDGE GAP WIDTH	0.44" / 0.44"
ESTIMATED CENTER GAP WIDTH upon receipt of specimen in laboratory (after stabilization)	0.44" / 0.47"
CENTER GAP WIDTH at laboratory ambient conditions on day of testing	0.44" / 0.47"
CENTER GAP WIDTH at test conditions	0.31" / 0.38"

Glass collapse determined using a digital glass and air space meter

The sample was inspected for the formation of frost or condensation, which may influence the surface temperature measurements. The sample showed no evidence of condensation/frost at the conclusion of the test.

“This test method does not include procedures to determine the heat flow due to either air movement through the specimen or solar radiation effects. As a consequence, the thermal transmittance results obtained do not reflect performances which are expected from field installations due to not accounting for solar radiation, air leakage effects, and the thermal bridge effects that have the potential to occur due to the specific design and construction of the fenestration system opening. The latter can only be determined by in-situ measurements. Therefore, it is important to recognize that the thermal transmittance results obtained from this test method are for ideal laboratory conditions and should only be used for fenestration product comparisons and as input to thermal performance analyses which also include solar, air leakage and thermal bridge effects.”

Required annual calibrations for the Intertek B&C, 'thermal test chamber' (ICN 000001) in York, Pennsylvania were last conducted in May 2025 in accordance with Intertek B&C calibration procedure. A CTS Calibration verification was performed June 2025. A Metering Box Wall Transducer and Surround Panel Flanking Loss Characterization was performed June 2025.

The reported Standardized Thermal Transmittance (Ust) was determined using CTS Method, per Section 9.2(A) of NFRC 102.

TEST REPORT FOR SUZHOU TRYBA BUILDING MATERIALS TECHNOLOGY CO., LTD

Report No.: R7714.01-116-46 R0

Date: 08/05/25

SECTION 12

CTS CALIBRATION DATA

1. CTS Test Date	12/21/24
2. CTS Size	21.53 ft ²
3. CTS Glass/Core Conductance	0.41 Btu/hr·ft ² ·F
4. Warm Side Air Temperature	69.81 F
5. Cold Side Air Temperature	-0.40 F
6. Warm Side Average Surface Temperature	54.01 F
7. Cold Side Average Surface Temperature	3.65 F
8. Convection Coefficient (Kc)	0.32 Btu/(hr·ft ² ·F ^{1.25})
9. Measured Cold Side Surface Conductance (hc)	5.13 Btu/hr·ft ² ·F
10. Measured Thermal Transmittance	0.31 Btu/hr·ft ² ·F

ANSI/NCSL Z540-2-1997 type B uncertainty for this test was 2.17%.

Unless differently required, Intertek reports apply the "Simple Acceptance" rule also called "Shared Risk Approach," of ILAC-G8:09/2019, Guidelines on Decision Rules and Statements of Conformity.

"Ratings included in this report are for submittal to an NFRC licensed IA for certification purposes and are not meant to be used for labeling purposes. Only those options identified on a valid Certificate of Authorization (CA) are to be used for labeling purposes."

The direction of heat transfer was from the interior (warm side) to the exterior (cold side) of the specimen. The ratings were rounded in accordance to NFRC 601, NFRC Unit and Measurement Policy. The data acquisition frequency is 5 minutes.

TEST REPORT FOR SUZHOU TRYBA BUILDING MATERIALS TECHNOLOGY CO., LTD

Report No.: R7714.01-116-46 R0

Date: 08/05/25

SECTION 13

SURROUND PANEL WIRING DIAGRAM



TEST REPORT FOR SUZHOU TRYBA BUILDING MATERIALS TECHNOLOGY CO., LTD

Report No.: R7714.01-116-46 R0

Date: 08/05/25

SECTION 14

BAFFLE WIRING DIAGRAM



TEST REPORT FOR SUZHOU TRYBA BUILDING MATERIALS TECHNOLOGY CO., LTD

Report No.: R7714.01-116-46 R0

Date: 08/05/25

SECTION 15

SUBMITTAL FORM AND DRAWINGS

The test specimen drawings which follow have been reviewed by Intertek B&C and are representative of the test specimen(s) reported herein. Test specimen construction was verified by Intertek B&C per the drawings included in this report. Any deviations are documented herein or on the drawings.

TEST REPORT FOR SUZHOU TRYBA BUILDING MATERIALS TECHNOLOGY CO., LTD

Report No.: R7714.01-116-46 R0

Date: 08/05/25

SECTION 16

REVISION LOG

REVISION #	DATE	PAGES	REVISION
.01 R0	08/05/25	N/A	Original Report Issue